


Path: C:\Users\sudha.graves\Desktop\Fairmont Pond\GIS\Fairmont Pond Water Sample Results\_2021\_0910.mxd

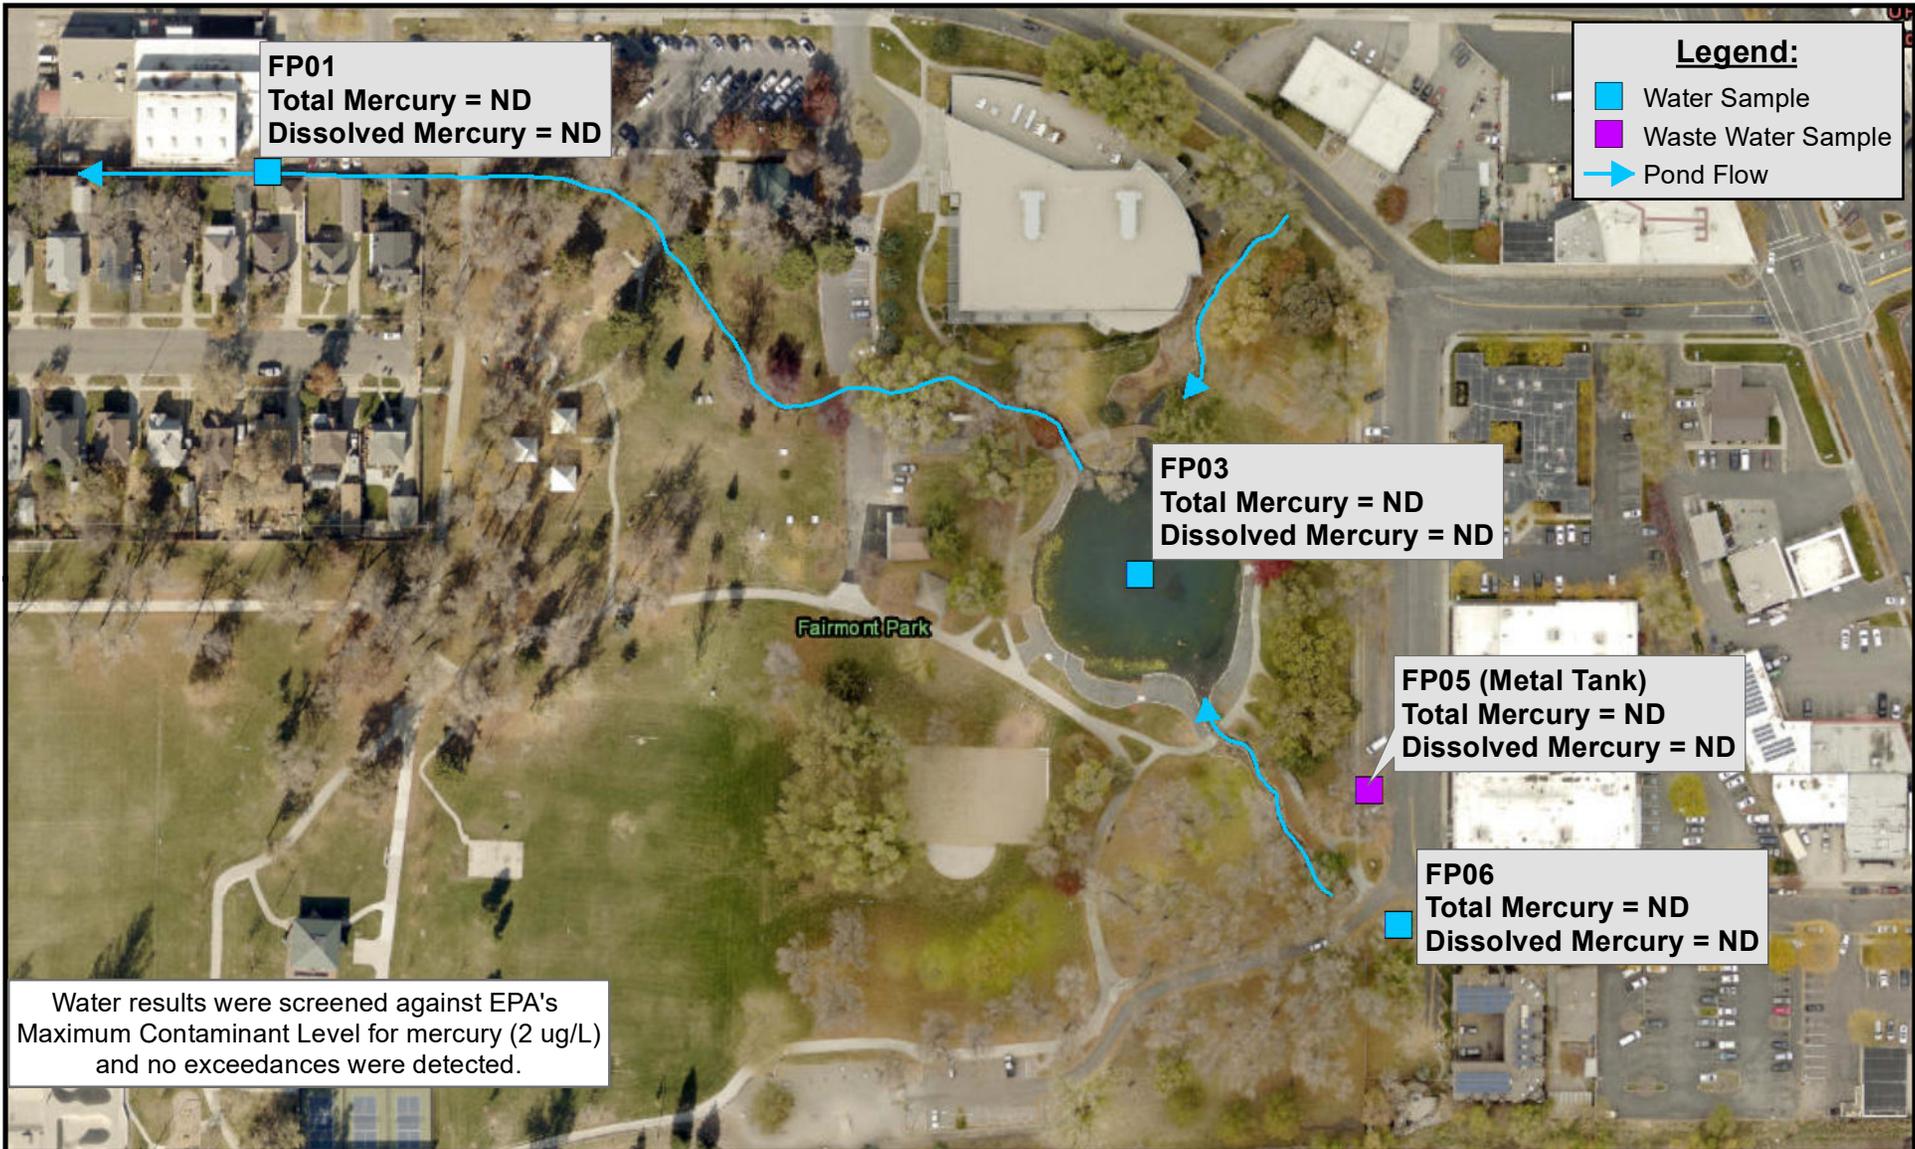

Water results were screened against EPA's Maximum Contaminant Level for mercury (2 ug/L) and no exceedances were detected.

Coordinate System: WGS 1984 Web Mercator Auxiliary Sphere  
Projection: Mercator Auxiliary Sphere  
Datum: WGS 1984

**Source:**  
Background: ESRI World Imagery (2021)  
Sample Locations: EPA Region 8 START (TetraTech)

**Notes:**  
ND = Not detected at or above the corresponding Minimum Reporting Limit (MRL)  
ug/L = microgram per liter

0 125 250 500 Feet



Prepared for:  
U.S. EPA - Region 8

Contract: 68HE0820D0001  
TO/TD: 2071-2109-02



<https://response.epa.gov/FairmontPond>

**WATER SAMPLE RESULTS  
COLLECTED 9/10/2021  
FAIRMONT POND SITE  
1040 E. SUGARMONT DRIVE  
SALT LAKE CITY, UTAH**